


SIDEWALK / MULTI-USE PATH AT BACK OF CURB
NOT TO SCALE

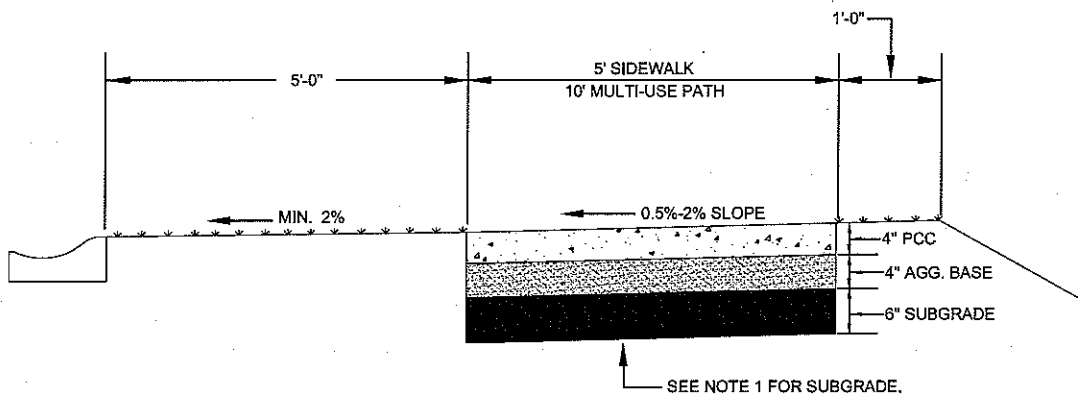

SIDEWALK / MULTI-USE PATH WITH GREEN SPACE
NOT TO SCALE

General Notes:

1. Subgrade under sidewalk shall be stable, compacted earth.
2. Aggregate base layer material & placement shall be in accordance with section 2202.
3. 2% maximum cross slope must be maintained through driveways unless otherwise approved by the city inspector. (SEE DRIVEWAY DETAIL RB-5)
4. Required concrete mix shall be KCMMB 4K Mix.
5. All sidewalks shall meet Federal ADA Requirements.
6. An expansion joint shall be placed at a maximum of 150 ft. Construction joints shall be placed the same width of sidewalk, but no greater than 10 ft.
7. Multi-use path width shall be 10 ft.
8. Sidewalk / multi-use path construction shall meet the requirements of the current Design & Construction Manual.
9. Sidewalk finishing as directed by City Inspector.
11. Curing compound must be applied to the concrete surface immediately after final finishing.

Approved By:

--	--

Name

Date



CITY OF LEE'S SUMMIT, MISSOURI
PUBLIC WORKS/ENGINEERING

SIDEWALK DETAIL

Date: 6/2011.

Drawn By: MJF

DWG: S1

Rev: 09/2007

Rev: